Wojewódzki Instytut Weterynarii w Bydgoszczy

CITY MULTI

# SYSTEM SCHEMATIC DWG.

| DIAGRAM SYMBOL LEGEND | |
|---|---|
| DISPLAY | DESCRIPTION |
| ——//—— | POWER WIRE |
| ———— | CONTROL WIRE |
| ———— | REF. PIPE |

| CONT.No | | PAGE | 1 / 1 |
|---|---|---|---|

Additional refrigerant charge is needed depending on the size and length of extended piping. Please refer the amount of pre-charge and the formula of calculation which is mentioned on the data book.
1.25mm²(16 AWG) : 1.25mm²(16 AWG) or more. 0.75mm²(20 AWG) : between 0.5mm²(24 AWG) and 0.75mm²(20 AWG).

| PIPING LIST | |
|---|---|
| SYMBOL | BRANCH PIPE MODEL NAME |
| J1 | CMY-Y102LS-G2 |
| J2 | CMY-Y102SS-G2 |
| SYMBOL | LIQUID PIPE/GAS PIPE SIZE |
| P1 | 12.7 / 22.2 |
| P2 | 9.52 / 15.88 |
| P3 | 9.52 / 22.2 |
| P4 | 6.35 / 12.7 |
| P5 | 9.52 / 19.05 |
| P6 | 9.52 / 25.4 |

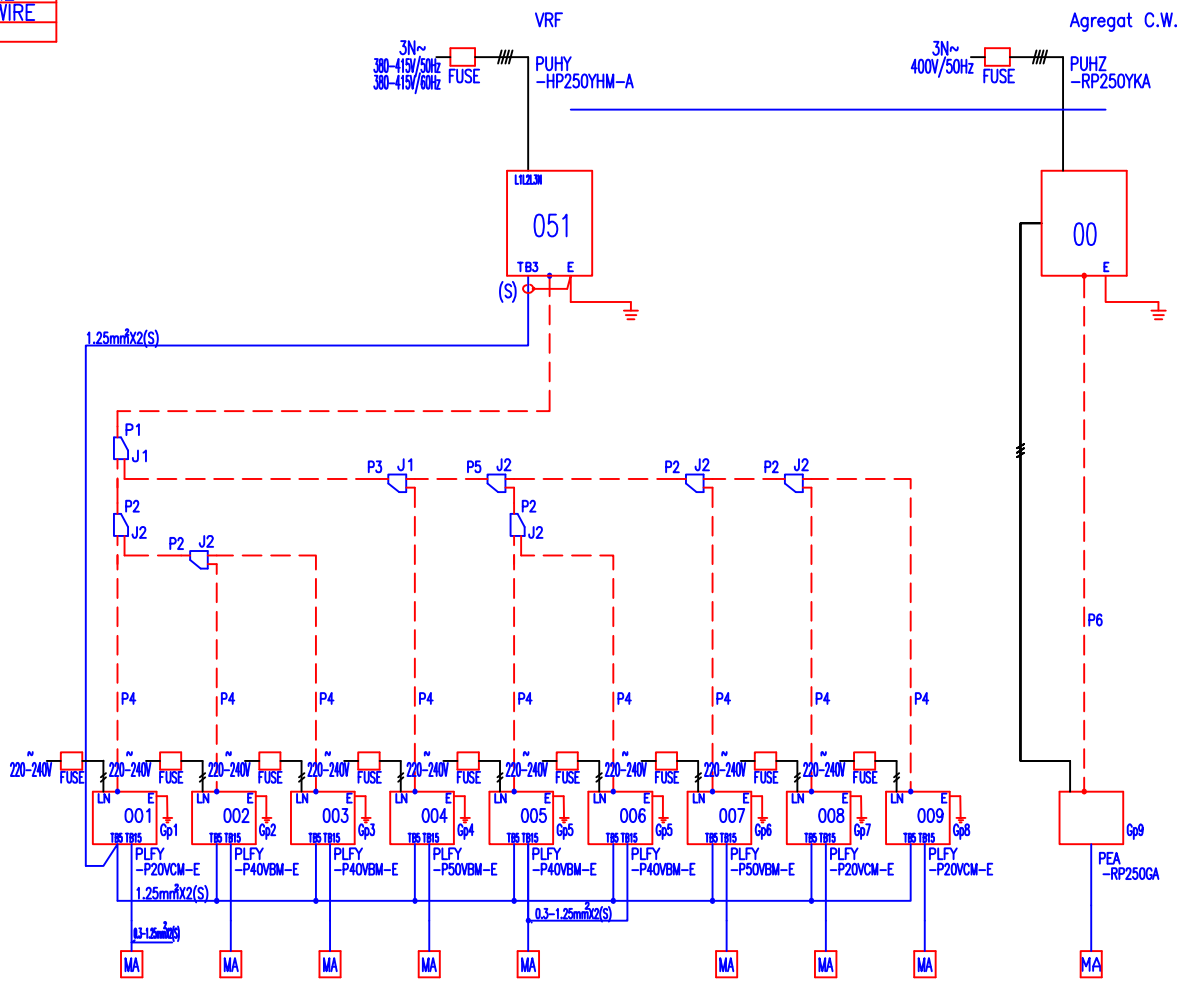


REMARKS

MITSUBISHI ELECTRIC CORPORATION

PREPARED ON 2012/10/16